

# WATER QUALITY

## CONSUMER CONFIDENCE REPORT 2017



City of  
Santa Clara  
The Center of What's Possible

## Report contains water quality monitoring results

The City of Santa Clara is committed to providing you, the water consumer, with a safe and reliable supply of high quality drinking water. Each year we publish an annual water quality report known as the Consumer Confidence Report. This is our 29th annual report on water quality. It contains the latest water quality monitoring results obtained through the end of calendar year 2016. It answers some of the most common water quality questions asked by our customers. We hope it will provide the facts and perspectives you need to make an informed evaluation of your tap water.

In order to ensure that tap water is safe to drink, the U.S. Environmental Protection Agency (USEPA) and the State Water Resources Control Board (State Board) prescribe regulations that limit the amount of certain contaminants in water provided by public water systems. The U.S. Food and Drug Administration regulations and California law also establish limits for contaminants in bottled water that provide the same protection for public health.

This report has been prepared in accordance with the requirements of the Safe Drinking Water Act and State regulations. Although the water you receive is tested for over 100 potential contaminants and 48 other parameters, the majority of the potential contaminants are never detected. To simplify the report, only the constituents that were detected in at least one water source appear in the water quality table. We are also required by the State to provide additional information about certain constituents that appear on the water quality table even though the water meets all applicable drinking water standards. The State allows us to monitor for some contaminants less than once per year because the concentrations of these contaminants do not change frequently. Some of our data, though representative, are more than one year old.



## Drinking water must meet standards

The quality of drinking water is carefully regulated by the federal government. In 1974, Congress passed the Safe Drinking Water Act, requiring the USEPA to establish uniform standards for drinking water. The Safe Drinking Water Act was further amended in 1986 and 1996, adding even more stringent standards. In California, these standards are enforced by the State Water Resources Control Board Division of Drinking Water.

There are two types of drinking water standards. **PRIMARY STANDARDS** are designed to protect public health. These standards specify the limits, called "Maximum Contaminant Levels" for substances in water that may be

We take great pride in delivering the safest and highest quality water available.

harmful to humans or affect their health if consumed in large quantities. **SECONDARY STANDARDS** are based on aesthetic qualities of water such as color, taste and odor. These standards specify limits for substances that may affect consumer acceptance of the water. Both Primary and Secondary Standards are listed in this report.

It is important to the City of Santa Clara that you, the water consumer, have current and factual information about your water supply. In this latest issue of our report, we hope to further your understanding and strengthen your confidence in the quality and integrity of the water supplied to you by the City of Santa Clara.



## Santa Clara water comes from three sources

The City of Santa Clara has three separate sources of drinking water. Often, these sources are used interchangeably or are blended together. Altogether these sources provide an average of 18 million gallons of water per day to the homes, businesses, industries and institutions of Santa Clara. In 2016, about 41% of our water was treated surface water purchased from the Santa Clara Valley Water District, imported from the Sacramento-San Joaquin Delta, and from the San Francisco Public Utility Commission's

See map of water sources on page 2


(SFPUC) Hetch-Hetchy System, imported from the Sierra Nevada Mountains.

District water serves primarily the southwesterly portion of the City. SFPUC Hetch-Hetchy water typically serves the area north of Highway 101. The remaining 59% is pumped from the City's system of 26 deep wells serving the rest of Santa Clara.

## Information and guidance for people with compromised immune systems

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. USEPA/Center for Disease Control guidelines on appropriate means to lessen the risk of infection by Cryptosporidium, and other microbial contaminants are available from the Safe Drinking Water Hotline 1-800-426-4791.

If you have any questions about information in this report, or if you want to participate in water quality related issues, call Mike Vasquez at the Water Utility at 408-615-2000 or email [MVasquez@SantaClaraCA.gov](mailto:MVasquez@SantaClaraCA.gov).

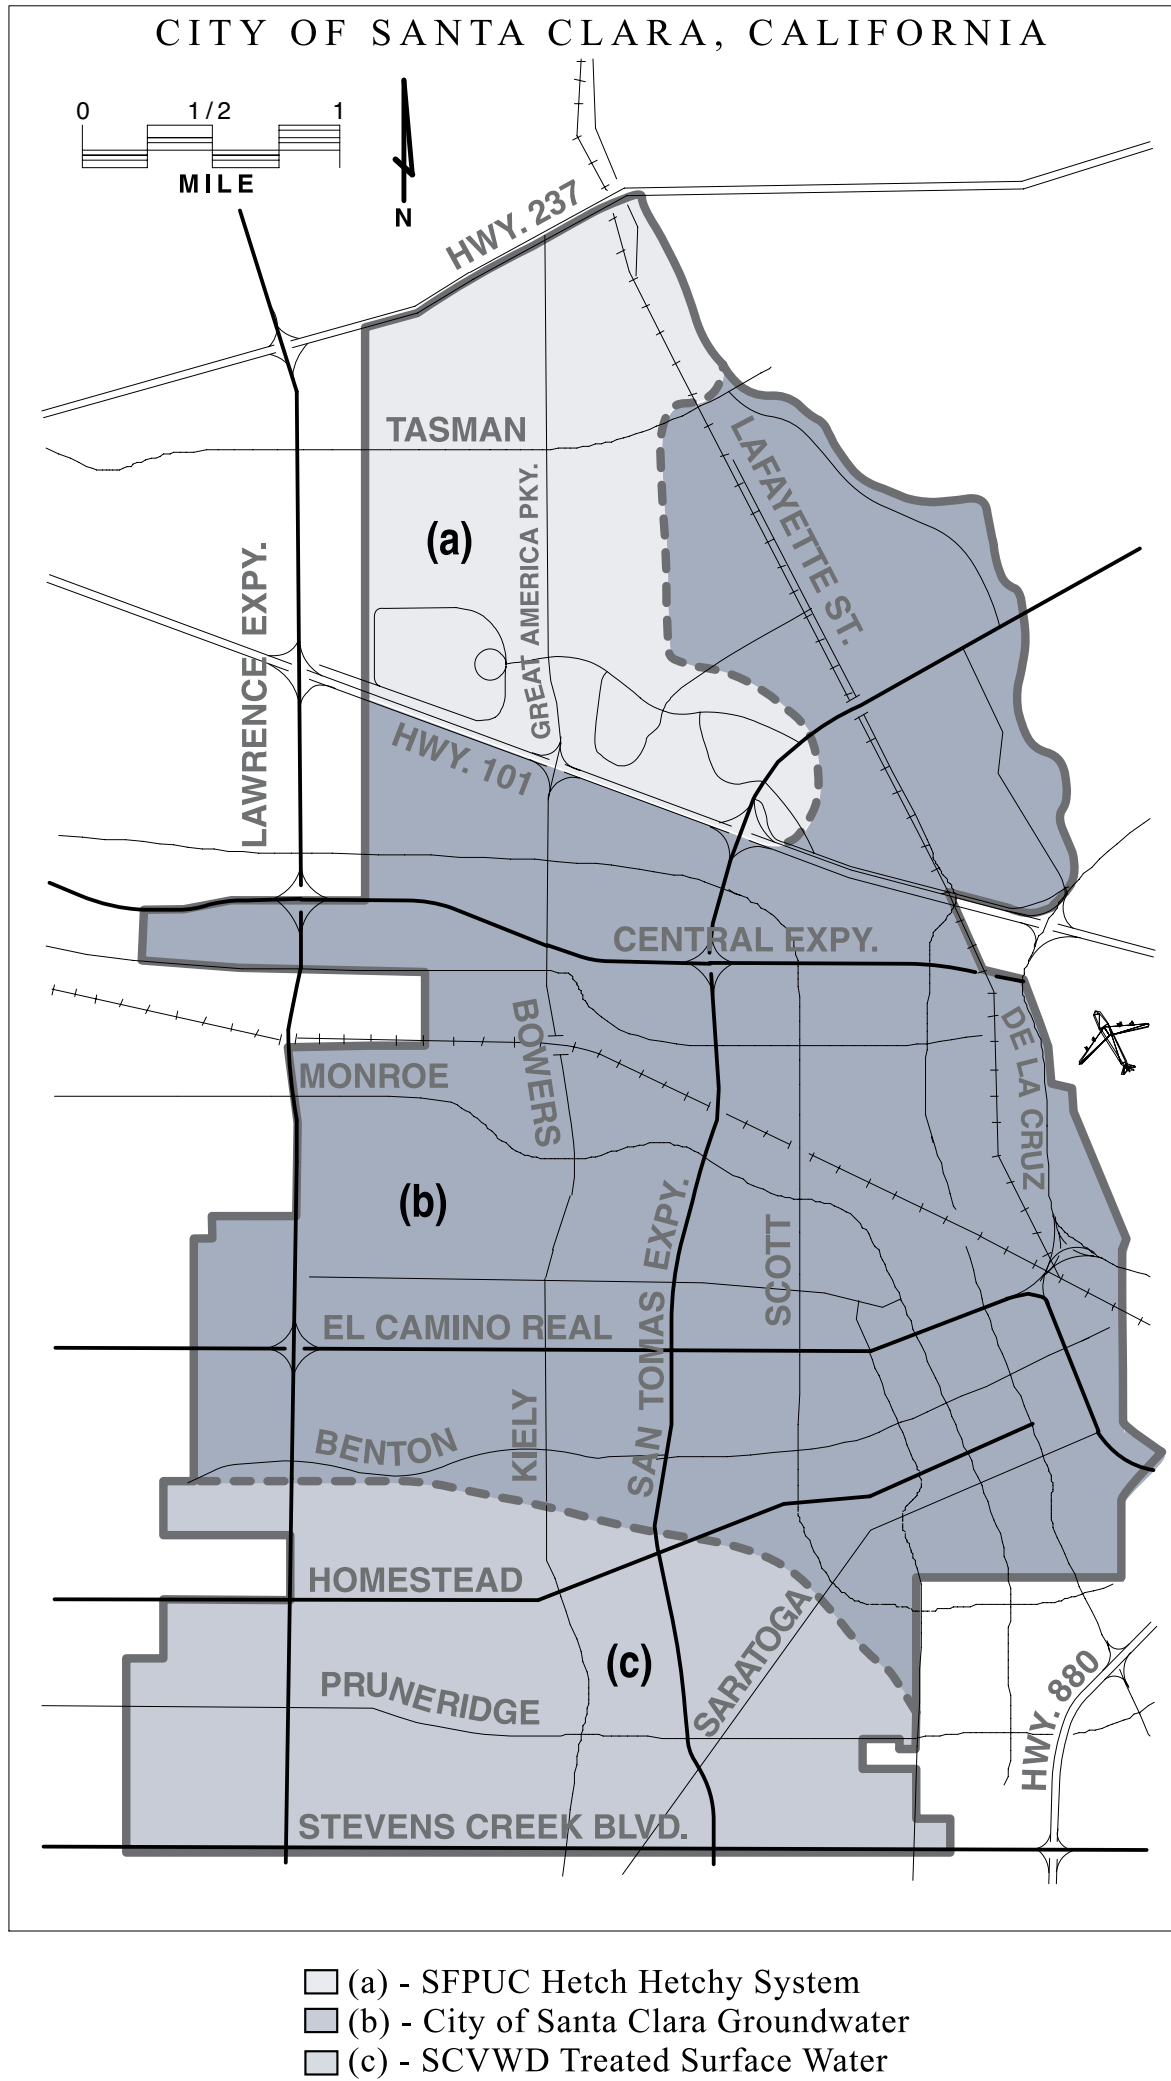

- (a) - SFPUC Hetch Hetchy System
- (b) - City of Santa Clara Groundwater
- (c) - SCVWD Treated Surface Water

## City wells

The majority of water consumed in the City of Santa Clara is pumped from the City’s system of deep wells. Well water is pulled up from groundwater – water that is located in aquifers (water-filled spaces between sand, gravel, silt and clay) deep in the ground. Aquifers are replenished by rainwater that infiltrates down from the land surface.

## Hetch Hetchy system

The City purchases water from the SFPUC Hetch Hetchy System. The SFPUC conducts watershed sanitary surveys for the Hetch Hetchy source annually and local water sources every five years. The last local sanitary survey was done in 2016. The SFPUC conducted a special watershed sanitary survey for Upcountry Non-Hetch Hetchy Sources in 2015 as part of its drought response plan efforts. These surveys evaluate the sanitary condition, water quality, potential contamination sources and the results of watershed management activities, and were completed with support from partner agencies including National Park Service and U.S. Forest Service. These surveys identified wildlife, stock, and human activities as potential contamination sources. You may contact the San Francisco District office of the State Water Resources Control Board at 510-620-3474 for the review of these reports.

## Santa Clara Valley Water District

The Santa Clara Valley Water District provides treated surface water to the Silicon Valley from three water treatment plants. District surface water is mainly imported from the South Bay Aqueduct, Dyer Reservoir, Lake Del Valle, and San Luis Reservoir, which all draw water from the Sacramento - San Joaquin Delta watershed. The District’s local water sources include Anderson and Calero Reservoirs.

The District’s source waters are vulnerable to potential contamination from a variety of land use practices, such as agricultural and urban runoff, recreational activities, livestock grazing, and residential and industrial development. The imported sources are also vulnerable to wastewater treatment plant discharges, seawater intrusion, and wild fires in open space areas. In addition, local sources are also vulnerable to potential contamination from commercial stables and historic mining practices. No contaminant associated with any of these activities has been detected in the District’s treated water. The water treatment plants provide multiple barriers for physical removal of contaminants and disinfection of pathogens. For more information, visit the District website at [ValleyWater.org](http://ValleyWater.org).

## Some Santa Clara water is fluoridated

Fluoride is nature’s cavity fighter. Fluoridation adjusts the naturally occurring fluoride in drinking water to the ideal level for protecting your teeth. Fluoridated drinking water benefits people of all ages by preventing tooth decay.

In November of 2005, the SFPUC Hetch Hetchy system completed construction of a fluoridation facility in the east bay. The water purchased by the City from the SFPUC is fluoridated, while water from the Santa Clara Valley Water District is not fluoridated. If your zip code is 95054, you are in the area receiving fluoridated water. However, this area is also served by well water that has not been fluoridated. Refer to the map above that shows the area supplied with water from both the Hetch-Hetchy system and the City’s wells. The majority of Santa Clara will continue to receive water without added fluoride.

State law requires the addition of fluoride to all water systems in California serving 10,000 customers or more. Fluoridation of the remaining water sources in the City would require installation of fluoride injecting equipment at each of the City’s 26 active wells and at its treated water connection from the Santa Clara Valley Water District. The law includes a provision for state funds to finance this fluoridation equipment, however it may be some time before the State can provide funding to move forward with a fluoridation program for the remainder of the City.

Contact your health provider if you have concerns about dental fluorosis. For additional information about fluoridation or oral health, visit the Centers for Disease Control website [CDC.gov/fluoridation](http://CDC.gov/fluoridation) or the State Water Resources Control Board website [Waterboards.CA.gov/drinking\\_water/certlic/drinkingwater/Fluoridation.shtml](http://Waterboards.CA.gov/drinking_water/certlic/drinkingwater/Fluoridation.shtml).





# City of Santa Clara Water Quality Table

	UNIT	MCL	State PHG/ Fed (MCLG)	analysis for City SC Well Water range	analysis for SCV Water District average	analysis for HETCH HETCHY range	analysis for HETCH HETCHY average or [max]	Common Sources of:	
<b>PRIMARY STANDARDS FOR SOURCE WATER SAMPLING:</b>									
<b>MICROBIOLOGICAL</b>									
giardia lamblia	cyst/L	TT	0	NA	NA	NA	NA	naturally present in environment	
<b>RADIOACTIVITY</b>									
Gross Alpha	pCi/L	15	(0)	ND	ND	ND	ND	erosion of natural deposits	
<b>INORGANIC CHEMICAL</b>									
Aluminum	PPM	1	0.6	0-0.029	ND	ND - 0.076	ND	natural deposits/treatment process	
Arsenic	PPB	10	0.004	ND-1.1	0.11	ND	ND	erosion of nat'l deposit/runoff	
Barium	PPM	1	2	0.085 - 0.12	0.1	ND	ND	erosion of nat'l deposit/oil drilling	
Chromium	PPB	50	(100)	ND - 2.4	0.97	ND	ND	erosion of nat'l deposit/plating	
Fluoride	PPM	2	1	0.11 - 0.18	0.15	ND	ND	water additive/erosion of nat'l deposits	
Hexavalent Chromium	PPB	10	0.02	0-0.72	0.72	ND	ND	erosion of natural deposits	
Nitrate (as Nitrogen)	PPM	10	10	0.39 - 6.1	3.3	ND - 1.1	ND	erosion of nat'l deposit/runoff/leaching	
<b>SECONDARY STANDARDS: "CONSUMER ACCEPTANCE CONTAMINANT LEVELS"</b>									
Aluminum	PPB	200	NA	0-29	2.9	ND	ND	natural deposits/treatment process	
Chloride	PPM	500	NA	27 - 69	49.9	59 - 96	76	runoff/leaching nat'l deposits/seawater	
Color	UNITS	15	NA	ND	ND	ND	ND	naturally occurring organic material	
Copper	PPM	1	NA	ND	ND	ND	ND	erosion of nat'l deposit/leaching	
Iron	PPB	300	NA	ND-0.03	0.003	ND	ND	leaching from nat'l deposits/ind. waste	
Manganese	PPB	50	NA	ND - 25	2.5	ND	ND	leaching from natural deposits	
Odor	UNITS	3	NA	ND - 2	1.1	1	1	naturally occurring organic material	
Sp. Conductance	uS/cm	1600	NA	540 - 760	656	401 - 581	510	subst. forming ions/seawater intrusion	
Sulfate	PPM	500	NA	31 - 48	38.5	38.7 - 64.6	49.7	runoff/leaching nat'l deposits/ind. waste	
Tot. Dissolved Solids	PPM	1000	NA	330 - 460	400	222 - 344	282	runoff/leaching from natural deposits	
Turbidity	NTU	5	NA	ND - 1.4	0.17	0.06 - 0.08	0.07	soil runoff	
<b>CONSUMER INFORMATION</b>									
pH	UNITS	NS	NS	7.8 - 8.2	8.0	7.5 - 8.0	7.7	8.2 - 9.8	9.4
Alkalinity (as CaCO3)	PPM	NS	NS	180 - 240	205	54 - 72	64	7 - 112	39
Hardness	PPM	NS	NS	170 - 320	268	71 - 115	95	8 - 76	44
Calcium (as Ca)	PPM	NS	NS	46 - 89	75	14 - 20	18	2-18	10
Magnesium	PPM	NS	NS	14 - 24	19.7	9 - 13	11	0.2 - 6	3.6
Sodium	PPM	NS	NS	24 - 49	30.9	47 - 72	56	2.6 - 17	11
Potassium	PPM	NS	NS	1.2 - 1.4	1.3	2.2 - 3.5	3	0.2 - 1	0.6
<b>PRIMARY STANDARDS AS MEASURED IN CITY OF SANTA CLARA DISTRIBUTION SYSTEM:</b>									
<b>MICROBIOLOGICAL</b>									
Total Coliform	% pos (+)	5.00%	(0)	0 - 1.4%	< 5%				naturally present in environment
<b>DISINFECTION BYPRODUCTS, RESIDUALS, PRECURSORS</b>									
Trihalomethanes	PPB	80	NA	0 - 75	[66.5]				byproduct of drinking water disinfection
Haloacetic Acids	PPB	60	NA	0 - 52	[44.5]				byproduct of drinking water disinfection
Chlorine residual	PPM	4	4	0.0 - 3.0	0.78				drinking water disinfectant
<b>INORGANIC CHEMICAL as measured at 50 Residential Taps in 2016:</b>									
Copper	PPM	AL = 1.3	0.3	90th percentile = 0.380ppm		Number Exceeded = 0			corrosion of plumbing systems
Lead	PPB	AL = 15	0.2	90th percentile = 3.2 ppb		Number Exceeded = 0			corrosion of plumbing systems
<b>UNREGULATED CONTAMINANTS AS MEASURED IN CITY OF SANTA CLARA DISTRIBUTION SYSTEM:</b>									
<b>NOTIFICATION LEVEL</b>									
Chlorodifluoromethane	PPB	NA		0 - 580	171.3				
Chlorate	PPB	800		0 - 98	38.2				
Chromium	PPB	NA		0 - 4.9	1.6				
Hexavalent Chromium	PPB	NA		0.03 - 4.1	1.5				
Molybdenum	PPB	NA		0 - 3.7	2.0				
Strontium	PPB	NA		260 - 430	315				
Vanadium	PPB	50		2.8 - 5.3	4.1				

[1] Turbidity is measured every four hours. These are monthly average turbidity values.  
 [2] The highest turbidity of the unfiltered Hetch Hetchy water in 2016 was 3.2 NTU.

## Definitions and Notes:

**Primary Drinking Water Standard (PDWS):** MCLs and MRDLs for contaminants that affect health along with their monitoring and reporting requirements, and water treatment requirements.

**MAXIMUM CONTAMINANT LEVEL (MCL):** The highest level of a contaminant that is allowed in drinking water. Primary MCLs are set as close to the PHGs (or MCLGs) as is economically and technologically feasible. Secondary MCLs are set to protect the odor, taste, and appearance of drinking water.

**MAXIMUM CONTAMINANT LEVEL GOAL (MCLG):** The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are set by the U.S. Environmental Protection Agency.

**MAXIMUM RESIDUAL DISINFECTANT LEVEL (MRDL):** The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

**MAXIMUM RESIDUAL DISINFECTANT LEVEL GOAL (MRDLG):** The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

**PUBLIC HEALTH GOAL (PHG):** The level of a contaminant in drinking water below which there is no known or expected risk to health. PHGs are set by the California Environmental Protection Agency.

**REGULATORY ACTION LEVEL (AL):** The concentration of a contaminant which, if exceeded, triggers treatment or other requirements that a water system must follow.

**TREATMENT TECHNIQUE (TT):** A required process intended to reduce the level of a contaminant in drinking water.

**UNREGULATED CONTAMINANTS:** Unregulated contaminant monitoring helps EPA and State Water Resources Control Board to determine where certain contaminants occur and whether the contaminants need to be regulated.

pCi/L = picocuries per liter (a measure of radioactivity)

PPM = Parts Per Million

PPB = Parts Per Billion

P = Present

A = Absent

<DLR = less than Detection Limit for Reporting

DISTRIBUTION SYSTEM = drinking water delivery system

RESIDENTIAL TAPS = household faucets used for lead and copper sampling

DISINFECTION BYPRODUCTS = chemical by products of disinfection

SECONDARY STANDARDS = secondary MCLs are set to protect the aesthetics of drinking water

NTU = Nephelometric Turbidity Unit. Turbidity is a measure of the cloudiness of the water. We monitor it because it is a good indicator of water quality.

uS/cm = microSiemens per centimeter

NA = not applicable or available

ND = not detected

NS = no standard

Copper and Lead Tap Monitoring was performed in August 2016.

VANADIUM = the babies of some pregnant women who drink water containing vanadium in excess of the notification level may have an increased risk of developmental effects, based on studies in laboratory animals

HARDNESS = the sum of polyvalent cations present in the water, generally magnesium and calcium. The cations are usually naturally occurring.

SODIUM = refers to the salt present in the water and is generally naturally occurring.

## ATTENTION

This report contains important information about your drinking water. Translate it, or speak with someone who understands it.

Chi tiết này thật quan trọng.  
Xin nhờ người dịch cho quý vị.

Atencion: Este informe contiene informacion muy importante sobre su agua beber. Traduzcalo o hable con alguien que lo entienda bien.

此份有關你的食水報告,內有重要資料和訊息,請找他人為你翻譯及解釋清楚。

Mahalaga ang impormasyong ito.  
Mangyaring ipasalin ito.

이 안내는 매우 중요합니다.  
본인을 위해 번역인을 사용하십시오.

यह सूचना महत्वपूर्ण है।  
कृपा करके किसी से :सका अनुवाद करायें।

ਇਹ ਸੂਚਨਾ ਮਹੱਤਵਪੂਰਨ ਹੈ।  
ਕ੍ਰਿਪਾ ਕਰਕੇ ਕਿਸੀ ਤੋਂ ਇਸ ਦਾ ਅਨੁਵਾਦ ਕਰਾਉ।

この報告書には上水道に関する重要な情報が記されており、翻訳を御依頼されるか、内容をご理解なさっておられる方にお尋ね下さい。



# Water Quality Monitoring

The City completed a Drinking Water Source Assessment and Protection Program for the groundwater sources in August 2002 and submitted it to the State Board in December 2002. A copy of the program is available at the City's Water Utility offices at 1500 Warburton Ave. You may request a summary of the individual assessments by contacting the Water Utility at 408-615-2000 or by email at [water@SantaClaraCA.gov](mailto:water@SantaClaraCA.gov).

The City's groundwater sources are considered most vulnerable to contamination by: leaking underground tanks containing fuel or dry-cleaning chemicals; old, unrecorded septic systems; storm drain dry wells located at various places around the City; many old, shallow, private wells, abandoned and not properly destroyed; and possibly some contaminants from a small landfill dump left over from the early years of the 20th century.



## Lead

There have been no exceedances of the ACTION LEVEL for lead in the City of Santa Clara groundwater sources or supplies purchased from other agencies. It is possible for lead levels in your home to be higher than other homes in the community because of plumbing materials used in the original construction of your home. If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. The City of Santa Clara is responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your

water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline 1-800-426-4791 or at [EPA.gov/lead](http://EPA.gov/lead).

## Nitrates

Nitrate in drinking water at levels above 10 mg/L is a health risk for infants less than six months old. Such nitrate levels in drinking water can interfere with the capacity of the infant's blood to carry oxygen, resulting in serious illness; symptoms include shortness of breath and blueness of the skin. Nitrate levels above 10 mg/L may also affect the ability of the blood to carry oxygen in other individuals, such as pregnant women and those with certain specific enzyme deficiencies. If you are caring for an infant, or you are pregnant, you should ask for advice from your health care provider.

## Cryptosporidium and Giardia

Cryptosporidiosis is a disease of the intestinal tract brought on by a parasitic microbe (a protozoan) called Cryptosporidium. The disease is transmitted through contaminated water, food or direct contact with human or animal waste. If you are healthy with a normal immune system, the flu-like symptoms usually last about two weeks. Symptoms include diarrhea, stomach cramps, upset stomach and slight fever. However, immuno-compromised people, infants, small children, and the elderly are at greater risk of developing life-threatening illness.

The water purchased by the City from the SFPUC Hetch Hetchy system has been tested for Cryptosporidium and Giardia. The source waters and treated waters are tested at least monthly and occasionally show very low levels of Cryptosporidium in the waters serving the East Bay, South Bay and San Francisco Peninsula. Giardia, another parasitic organism causing similar symptoms, is monitored with the same frequency and very low levels are occasionally detected in the same source waters.

The general public is at very low risk and there have been no reported cases of Cryptosporidiosis and Giardiasis attributed to the City's public water supply. This advisory applies to water received from the Hetch Hetchy system in the area of the City north of Highway 101. The CDPH issues guidance for people with serious immune system problems. Currently, available guidance from the state and county health agencies recommends that people with such conditions consult with their doctor or primary health care provider about preventing Cryptosporidium and Giardia infection from all potential sources. Water consumers may choose to boil their drinking water at a rolling boil for at least one minute as an extra precaution.

For information about Cryptosporidiosis and Giardiasis, or copies of available guidance, contact the Santa Clara County Department of Environmental Health at 408-918-3400. You may also contact the USEPA Drinking Water Hotline at 1-800-426-4791.

## What are the sources of tap water?

Sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over land or through the ground, it dissolves naturally occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or human activity. Contaminants that may be present in source water include:

- Microbial contaminants, such as viruses and bacteria, that may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife
- Inorganic contaminants such as salts and metals that can be naturally-occurring or resulting from urban stormwater runoff, industrial or domestic wastewater discharges, oil and gas production, mining or farming
- Pesticides and herbicides that may come from a variety of sources such as agriculture, urban stormwater runoff and residential uses
- Organic chemical contaminants including synthetic and volatile organic chemicals that are by-products of industrial processes and petroleum production, and can also come from gas stations, urban stormwater runoff, agricultural application, and septic systems
- Radioactive contaminants that can be naturally occurring or be the result of oil and gas production and mining activities

In order to ensure that tap water is safe to drink, the U.S Environmental Protection Agency and the State Water Resources Control Board (State Board) prescribe regulations that limit the amount of certain contaminants in water provided by public water systems. The U.S. Food and Drug Administration regulations and California law also establish limits for contaminants in bottled water that provide the same protection for public health.

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the USEPA's Safe Drinking Water Hotline at 1-800-426-4791.

**Please share this information with all the other people who drink this water, especially those who may not have received this notice directly (for example, people in apartments, nursing homes, schools, and businesses). You can do this by posting this public notice in a public place or distributing copies by hand or mail.**

## IMPORTANT CONTACT INFORMATION

### City of Santa Clara

1500 Warburton Ave.  
Santa Clara, CA 95050  
408-615-2200  
[SantaClaraCA.gov](http://SantaClaraCA.gov)

### Water Utility

1500 Warburton Ave.  
Santa Clara, CA 95050  
Office hours: 8 a.m. – 5 p.m.,  
Monday-Friday  
408-615-2000

Water Billing Questions  
408-615-2300

Water Quality Report Questions  
Mike Vasquez  
408-615-2000  
[mvasquez@santaclaraca.gov](mailto:mvasquez@santaclaraca.gov)

### Water Emergencies

408-615-2000 Monday-Friday,  
8 a.m.-5 p.m.  
408-615-5640 other days  
and times

### Water Conservation

[Save20gallons.org](http://Save20gallons.org)  
408-630-2554 – Water  
Conservation Hotline and  
Rebate Information  
Sign up for a free Water-Wise  
House Call from Santa Clara  
Valley Water District by calling  
1-800-548-1882

### Web Resources

If you would like to learn more  
about drinking water quality,  
treatment and regulation,  
contact these organizations:

**American Water Works  
Association**  
[awwa.org](http://awwa.org)

**State Water Resources  
Control Board, Division of  
Drinking Water** [waterboards.ca.gov/drinking\\_water/programs/index.shtml](http://waterboards.ca.gov/drinking_water/programs/index.shtml)

**United States Environmental  
Protection Agency**  
[water.epa.gov/drink/index.cfm](http://water.epa.gov/drink/index.cfm)

**San Francisco Public  
Utilities Commission, Water  
Quality Bureau**

[sfwater.org/index.aspx?page=163](http://sfwater.org/index.aspx?page=163)

**Santa Clara Valley Water  
District**  
[valleywater.org](http://valleywater.org)

**Water Education Foundation**  
[watereducation.org](http://watereducation.org)

**Water Quality Information  
Center**  
[wquic.nal.usda.gov](http://wquic.nal.usda.gov)

### Public Input

To provide input on decisions  
that affect drinking water  
quality, you are welcome to  
provide input to the Santa  
Clara City Council at a Council  
meeting or in advance via mail,  
email or phone contact. A list  
of all City Council meetings,  
agenda items and study sessions  
can be viewed on the City  
website [SantaClaraCa.gov](http://SantaClaraCa.gov).

### eNotify

Sign up to receive news from the  
Water Utility  
[SantaClaraCA.gov](http://SantaClaraCA.gov)